

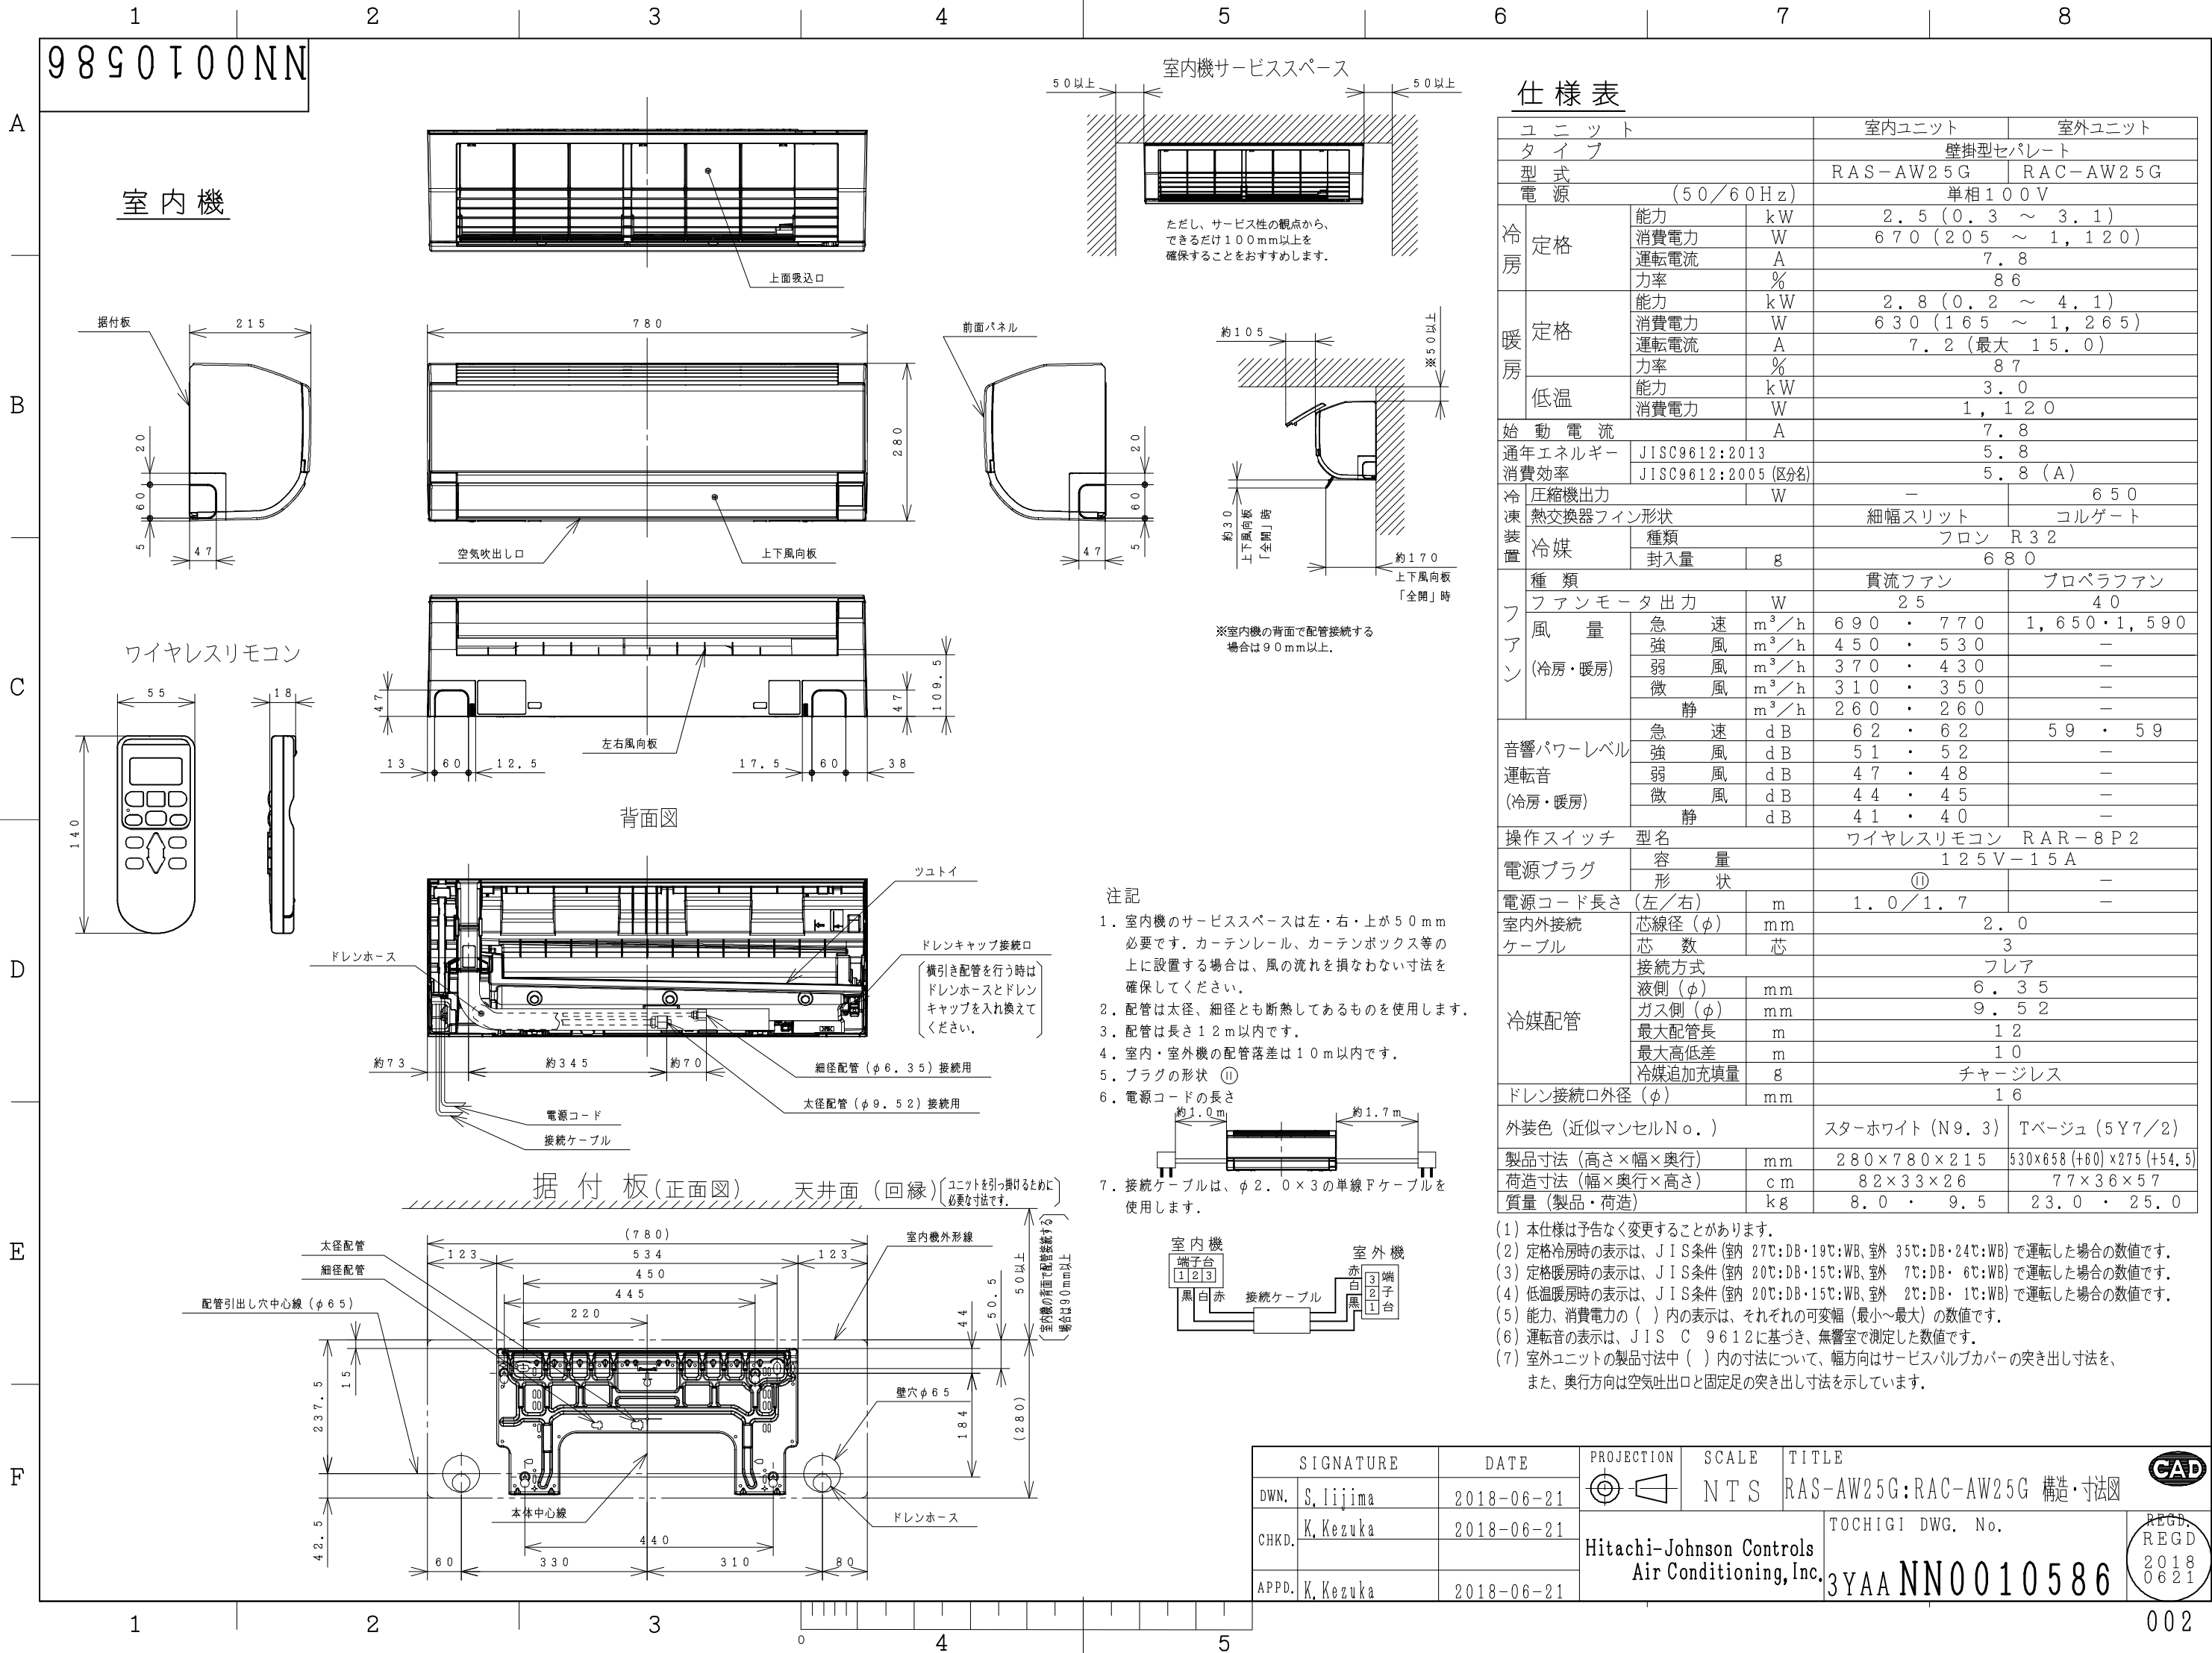




Diagram illustrating the clearance requirements for the outdoor unit (室外機) installation:

- Top Clearance:** 50 以上 (50 or more) to the ceiling/overhead structure (室外機サービススペース).
- Bottom Clearance:** 300 以上 (300 or more) to the ground. A note indicates a distance of 658 from the left wall to the start of the clearance zone.
- Left Clearance:** 100 以上 (100 or more) from the left wall.
- Right Clearance:** 200 以上 (200 or more) from the right wall.
- Unit Dimensions:** The unit itself is 275 high and 718 wide.
- Label:** The top of the unit is labeled "上面 200以上".

- | | | | | | | | |
|-----------|-----------|------------|---|--|----------------------------|---|------------------|
| SIGNATURE | | DATE |  | SCALE | TITLE |  | |
| DWN. | S. Iijima | 2018-06-21 | | NTS | RAS-AW25G:RAC-AW25G 構造:寸法図 | | |
| CHKD. | K. Kezuka | 2018-06-21 | | Hitachi-Johnson Controls
Air Conditioning, Inc. | | | TOCHIGI DWG. No. |
| APPD. | K. Kezuka | 2018-06-21 | | | | | 3YAA NN0010587 |

SIGNATURE		DATE	 	SCALE	TITLE		
DWN.	S. Iijima	2018-06-21		NTS	RAS-AW25G: RAC-AW25G 回路図: 配線図		
CHKD.	K. Kezuka	2018-06-21		TOCHIGI DWG. No.			
APPD.	K. Kezuka	2018-06-21		Hitachi-Johnson Controls Air Conditioning, Inc. 3YDA NN0010588			